

LED INDICATION	STATUS	COMMENTARY
Permanent Green	Everything Working Correctly	
Fast Flashing Green (0.1 Sec ON - 0.1 sec OFF)	Function Test in Progress	
Slow Flashing Green (1 sec ON-1 sec OFF)	Duration Test In Progress	
Permanent Yellow	Load Failure	Open Circuit/Short Circuit/LED Failure
Slow Flashing Yellow (1 sec ON-1 sec OFF)	Battery Failure	Battery Failed Duration or Function Test Battery is Defective/Wrong Battery Voltage
Fast Flashing Yellow (0.1 sec ON-0.1 sec OFF)	Charging Failure	Incorrect Charging Current
Green and Yellow OFF	DC Mode	Battery Operation(Emergency Mode)



### TECHNICAL INFORMATION

Model Number	Input Voltage	Charge Duration	Discharge Duration	Battery	Power Consumption	LED	Lumen output
XT200M3H/DALI	220-240V~ 50/60HZ	24 h	3 h	Ni-Mh 3.6V 2.6Ah	5 W	CREE XT-E	150 lm

### Explanations

	Maintained Luminaire	Non-maintained Luminaire	Switched Maintained Luminaire	
				OK
				Emergency mode
				Failure-Battery Charge

### Photometric

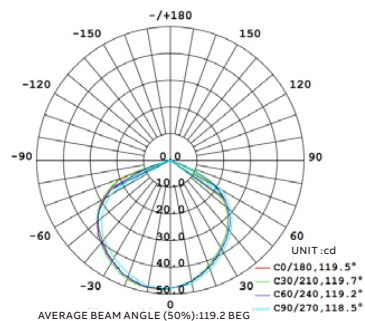

## XT200M3H/DALI

### Instruction Leaflet

**ABB BV**  
 C/O Thomas & Betts European Centre  
 Boulevard Millenium 8  
 B – 7110 Houdeng-Goegnies  
 Belgium

**UK Contact**  
 Telephone +44 (0) 113 281 0600  
 Sales +44 (0) 113 281 0610  
 Fax +44 (0) 113 281 0601  
 Email LV.enquiries@gb.abb.com

**Deutschland Kontakt:**  
**Busch-Jaeger Elektro**  
 Ein Unternehmen der ABB Gruppe  
 Freisenbergerstrasse 2  
 58513 Lüdenscheid

Zentraler Vertriebsservice  
 Tel: +49 (0)2351 956 1600  
 Fax: +49 (0)2351 956 1700

Website: [solutions.abb/led-sicherheitsbeleuchtung](http://solutions.abb/led-sicherheitsbeleuchtung)

**Other countries:**  
 For more information, please reach out to our ABB local contact center.  
 Find out on: [new.abb.com/contact-centers](http://new.abb.com/contact-centers)

Note: We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders and/or contracts, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilisation of its contents - in whole or in parts - is forbidden without prior written consent of ABB.

Copyright © 2020 ABB  
 All rights reserved

### Technical Specifications

Power Supply	: 220-240VAC, 50/60 Hz	Max. Case Temp.	: 70°C
Power Consumption	: Max. 5W	Emergency Duration	: 1 Hour / 3 Hours
Ambient Operating Temp:	0°C-40°C	Protection Class	: II
Charge Time	: 24 Hours	IP Rating	: IP20
Operation	: Maintained or non-maintained		

## GENERAL INFORMATION

LED Emergency down light for both open area and escape routes.  
Product has polycarbonate housed LED light source with low power consumption giving extended battery life.

## PRECAUTIONS

Carefully read this instruction leaflet before installing or using the luminaire.  
This leaflet provides important information about the correct installation, use, maintenance and disposal of this product. Please observe the following guidelines:

1. Installation must be in accordance with European installation requirements HD 60364 and additional local regulations.
2. This product may not be modified in any way what so ever or used for a purpose or in an environment other than for which it is designed. Failing to observe these guidelines will invalidate the warranty and the CE-compliance of this product.
3. The luminaire is suitable for indoor use only
4. Before installing the luminaire, the supply must be isolated.
5. The luminaire should be connected to the voltage equivalent to that indicated on the type label

## SERVICE & OPERATION

**Normal Operation:** The green indicator light on face plate stays on. The LED will go out if the mains supply fails, the internal charger malfunctions, or the unit is in test mode.


**Battery:** Sealed Ni-Cad or Ni-Mh rechargeable battery pack. Battery should be replaced when the required duration is no longer achieved. To avoid any damage to the fixture and ensure its performance, the battery should be replaced with same brand and type.

## WARNING:


The luminaire must, under no circumstances, be covered with insulating material or similar material only

## INSTALLATION

- ① NOTICE:  
Luminaire suitable for ceiling void 130mm min.  
Luminaire suitable for ceiling surface thickness 1-25mm




- ④ Remove AC supply end cap by blade screwdriver, unscrew cable clamp and through AC supply cable and DALI cable (DALI model only) then make wiring.



After wiring, tighten screw, cables is fixed by cable clamp, restore end cap.


- ② Cut out a recessed hole for luminaire mounting.



- ③ Through power supply cable out the mounting hole.  
Through DALI cable out the mounting hole if the luminaire has DALI function.




A, Make Maintained or Non-Maintained wiring.



Maintained (default operation):  
Connect L, N and leave jumper cable connected.


Non-maintained:  
Connect L, N and remove jumper cable.

B, Make ACEM wiring (switchable maintained).




Connect L, N and remove jumper cable and connect switched line between SL and L terminal.


- ⑤ Make battery connection.



- ⑥ Through LED driver and Battery module into cut out hole.




- ⑦ Insert lamp head into cut out hole.

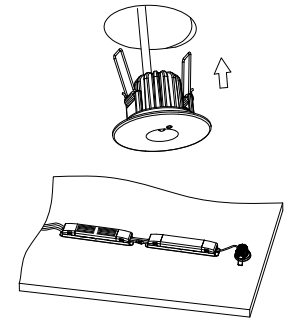

## MOUNTING SPACING

h(m)	MF 1.00				MF 0.8			
	Xa	Xb	Yb	Ya	Xa	Xb	Yb	Ya
2.5	3.62	8.87	8.90	3.79	3.35	8.34	8.37	3.49
3	3.81	9.61	9.61	3.96	3.48	8.98	8.93	3.62
3.5	3.91	10.20	10.13	4.07	3.51	9.47	9.37	3.68
4	3.92	10.65	10.54	4.12	3.47	9.79	9.7	3.65



The spacing table is based on the following parameters:  
 • Even escape routes  
 • Emergency lighting factor: 1.00  
 • Minimum illuminance on centre line: 1.00 lx  
 • Minimum illuminance on half of escape route width: 0.50 lx  
 • Diversity on the centre line max. 40 : 1  
 • Width of escape route: 2.00 m

## Commissioning Test Behaviour

Initial connection of the mains supply will initiate a commissioning sequence where the battery will remain on charge and test for an uninterrupted 60 hours. Any interruption of the mains supply during this period will reset the counter to zero.

The sequence is : to charge for 24hours. Having fully charged the battery, then execute a duration test. Upon successful completion of the duration test, the gear will perform another full charge period of 24hours. After this period, it is suggested to perform a function test and then check for successful completion of the function and duration tests.

Therefore, after initial mains power on, it is best to leave the gear alone for 60 hours to allow the gear to complete its pre-programmed commissioning testing. During the 60 hour period, any attempt to have the gear perform a function or duration test will simply result in the requested test being 'pending'. Following the commissioning test it will then perform whatever tests are pending. Meaning that if you had pressed "start duration test", at the end of commissioning, the gear will perform another duration test and another subsequent charge period before normal operations could be resumed.

## Gear Behaviour After Battery Change (meaning Disconnect / Reconnect battery)

After changing the battery, the gear will perform a complete commissioning sequence, as described above, irrespective of the condition of the battery.

## Function test

A 5 second functional test is carried out at nominally 1 week interval.

## Duration test

The gear switches to battery supply with mains supply off, and runs until the batteries can no longer supply the lamp

The length of time to run out is recorded in memory.

A pass result indicates the battery powered the fitting and lamp for the rated period of this fitting.

A full rated duration test is carried out nominally at 52 weeks intervals.

In DALI mode, the start of the regular duration and function tests, is initiated by the attached controller. If the DALI controller is not available, the gear will revert to its automated settings.