

## Lab and Pressurized Room Controllers with Off-board Air Modules



**Lab Controller Module.**



**Off-board Air Module 550-819B.**

The Laboratory Control Modules (LCMs) and Pressurized Room Controllers (PRCs) are available on a new hardware platform. These controllers use the Off-board Air Module (OAM) to measure airflow for standard and custom pressurized room control applications.



**NOTE:**

The 550-767.xN laboratory controllers have new 29xx application numbers. New application numbers may require front-end graphics and reporting modifications. Upgrading to the new controllers might, in some rare instances, cause some programming rework.

### Lab Controller Module

The LCM operates as an independent, stand-alone DDC controller and can be connected on the Floor Level Network (FLN). The LCM includes the largest physical point count of any FLN device. Not all physical points are used in all applications.

### Off-board Air Module

The OAM contains the air velocity sensor (a specialized differential pressure transducer), V/F conversion circuitry and solenoid for auto-zero function. Advanced digital signal processing produces a highly accurate reading of even the noisiest flow signals.

The auto-zero solenoid connects to the air velocity pressure transducer's inlet ports to enable automatic periodic re-calibration. This re-calibration ensures accurate, drift-free airflow measurement. Automatic re-calibration of the differential pressure transducers occurs upon system power-up and when airflows are stable with frequency selectable from 1 to 6 times a day.

**NOTE:**

Enhanced 550-767xN laboratory controllers **must use 550-819B** Off-board Air Modules (OAM). Using 550-818B with enhanced 550-767xN controllers will not work. 550-818B OAM are to only be used for legacy 550-767x controllers.

## Features

- Enhanced Room Unit functionality, including room humidity and CO<sub>2</sub> monitoring for 550-767xN controllers.
- Enhanced Room Unit functionality, including improved handling of communication losses and thermistor input selections 550-767xN controllers.
- LCM can be factory mounted on terminal units or Venturi Air Valves, or field mounted in panels located for easier access.
- OAM factory mounted on terminal units or Venturi Air Valves eliminates field installation of airflow signal tubing.
- Control applications available for a variety of airflow control devices, including dampers, terminal units, fans with VFDs and Venturi air valves.
- Control applications using a variety of actuation types including high-speed electronic, low-speed electronic and pneumatic (with transducers).
- Control applications that do not use a general exhaust, does not require a second OAM.
- Airflow sensor is read five times per second, independent of the output device loop time, giving the most accurate reading at all times.
- Airflow sensor is automatically recalibrated periodically to maintain highest accuracy.
- BTU Compensation temperature control application allows tighter control without over-cooling or over-heating during transients (requires discharge temperature sensor).
- Supports the use of wall switch input to change from occupied to unoccupied state.
- Optional room pressurization alarm output to notify laboratory occupants.
- Reports airflow directly in actual CFM (LPS).
- Electrically Erasable Programmable Read Only Memory (EEPROM) used for storing control parameters—no battery backup or re-entry of data required.
- Quick return from power failure without operator intervention that maintains room pressure relationship.

- Maintains room pressurization during transient conditions.
- Plenum rated controller.
- User-adjustable offset for the calibration of room temperature reading when required for validation purposes. See *Application Information*.
- Secure Mode prevents unauthorized users from making changes to the TEC through the MMI port or room sensor, supporting FDA 21 CFR Part 11 compliance guidelines for protection of electronic records. See *Application Information*.

## Room Sensor/Room Unit

The room sensor connection to the controller board consists of a quick-connect RJ-11 jack. This streamlines installation and reduces controller start-up time.

## Combination Temperature, Carbon Dioxide, and Relative Humidity Models

The Series 2200/2300 range of room unit, usable with the LCM/PRCs, includes temperature only or combination temperature/humidity, temperature/CO<sub>2</sub>, or temperature/CO<sub>2</sub>/humidity models. For these models, all measurement variables—CO<sub>2</sub>, temperature and relative humidity values—are passed digitally to the LCM/PRC. This information is passed from the room unit through the RJ-11 cable to the RTS port on the LCM/PRC.

**NOTE:**

A CO<sub>2</sub> power module (product number AQM2200) is also needed for the CO<sub>2</sub> sensor option to function.

## Lab and PRC Specifications

|   |                                 |
|---|---------------------------------|
| Dimensions  | 4-1/8" W × 11-1/4" L × 1-1/2" H |
| Weight  | Approx. 3 lbs (1.35 kg)         |
| Controlled Temperature Accuracy, Heating or Cooling | ±1.5°F (0.9°C)                  |

| Power Requirements |                            |
|--------------------|----------------------------|
| Operating Range    | 24 Vac +/-20%, 50 or 60 Hz |
| Power Consumption  | 7 VA (plus 12 VA per DO)   |

| Inputs  |   |
|---------|---|
| Analog  | 1 room temperature sensor (10K thermistor)<br>2 air velocity sensors (only for OAM inputs)<br>1 setpoint (optional at RTS)<br>1 auxiliary temperature sensor (100K thermistor)<br>2 selectable 0-10 Vdc/4-20 mA |
| Digital | 2 dry contacts  |

| Outputs |  |
|---------|--|
| Analog  | 3 0-10 Vdc   |
| Digital | 8 DO 24 Vac optically isolated solid state switches @ 0.5 amp<br>1 DO dedicated to AZ function |

| Airflow Sensing and Control     |  |
|---------------------------------|--|
| OAM Measurement Range Accuracy  | 0 to 5600 fpm (0 to 26 m/s)<br>3.5% reading maximum error from velocity pressure of 0.023"WC(5 Pa) |
| Controller Temperature Accuracy | ± 1.5 F (0.9 C)  |

| Communications |   |
|----------------|---|
| Remote         | BACnet MS/TP (EIA 485), 9600 bps to 76800 bps FLN Trunk |
| Local          | WCIS and PTEC Tool                                      |


| Ambient Conditions             |                                |
|--------------------------------|--------------------------------|
| Shipping & Storage Temperature | -13°F to 158°F (-25°C to 70°C) |
| Operating Temperature          | 32°F to 122°F (0°C to 50°C)    |
| Humidity Range                 | 5% to 95% rh (non-condensing)  |

# Application Information


New product/application number includes enhanced Room Unit functionality that enables room humidity and CO2 monitoring.

| LCM/P/N   | Application | Airflow Control               |  | Temperature Control             |        | Application Notes  |
|-----------|-------------|-------------------------------|--|---------------------------------|--------|--|
|           |             | Device                        | Output Type                              | Application                     | Output |  |
| 550-767CN | 2920        | Venturi                       | High-speed Modulating                    | Room Temp Sensor                | 0-10V  | Flow-Tracking, compatible with VAV fume hood control. OCC and UOC states have separate, selectable: >Differential Flow Setpoint >VAV or CAV Temp Control Mode. Room Temperature Offset for single-point calibration and SECURE MODE for Part 11 compliance solution. |
|           | 2926        |                               |  | BTU Comp [Discharge Temp Req'd] |        |  |
| 550-767DN | 2922        | Venturi                       | Low-speed Modulating                     | Room Temp Sensor                | 0-10V  | Flow-Tracking, compatible with CV2 fume hood control. OCC and UOC states have separate, selectable: >Differential Flow Setpoint >VAV or CAV Temp Control Mode. Room Temperature Offset for single-point calibration and SECURE MODE for Part 11 compliance solution. |
|           | 2928        |                               |  | BTU Comp [Discharge Temp Req'd] |        |  |
| 550-767EN | 2921        | Damper                        | High-speed 3-state                       | Room Temp Sensor                | 0-10V  | Flow-Tracking, compatible with VAV fume hood control. OCC and UOC states have separate, selectable: >Differential Flow Setpoint >VAV or CAV Temp Control Mode. Room Temperature Offset for single-point calibration and SECURE MODE for Part 11 compliance solution. |
|           | 2927        |                               |  | BTU Comp [Discharge Temp Req'd] |        |  |
| 550-767FN | 2923        | Damper                        | Low-speed 3-state                        | Room Temp Sensor                | 0-10V  | Flow-Tracking, compatible with CV2 fume hood control. OCC and UOC states have separate, selectable: >Differential Flow Setpoint >VAV or CAV Temp Control Mode. Room Temperature Offset for single-point calibration and SECURE MODE for Part 11 compliance solution. |
|           | 2929        |                               |  | BTU Comp [Discharge Temp Req'd] |        |  |
| 550-767GN | 2924        | Damper supply Venturi exhaust | Low-speed Modulating / Low-speed 3-state | Room Temp Sensor                | 0-10V  | Flow-Tracking, compatible with CV2 fume hood control. OCC and UOC states have separate, selectable: >Differential Flow Setpoint >VAV or CAV Temp Control Mode. Room Temperature Offset for single-point calibration and SECURE MODE for Part 11 compliance solution. |
|           | 2930        |                               |  | BTU Comp [Discharge Temp Req'd] |        |  |

**NOTE:** Setpoint hardware adapter is required when using 10K duct sensor in place of room temperature sensor.

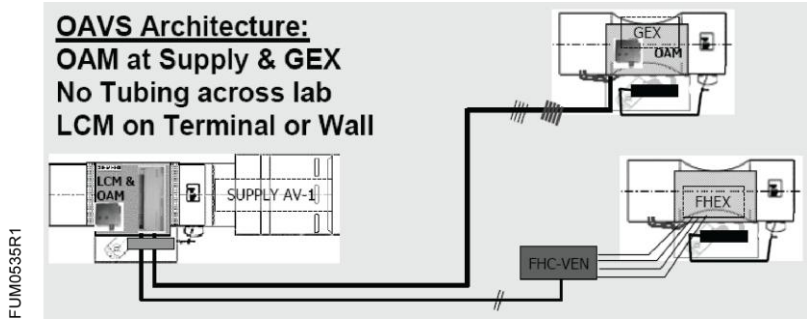

| PRC/P/N   | Application | Airflow Control |  | Temperature Control  |   | Application Notes   |
|-----------|-------------|-----------------|--|--|---|---|
|           |             | Device          | Output Type                              | Application  | Output  |   |
| 550-767NN | 2963        | Damper          | Low-speed<br>3-state                     | Room Temp<br>or Discharge<br>Temp<br>Sequenced<br>with Radiation | REHEAT 3-<br>pos/0-10V<br><br><i>(Optional)</i><br>RADIATION<br>0-10V | Flow-Tracking, NO FH FLOW INPUT.<br>Separate Heating & Cooling Setpoints<br>Two pressurization states.<br>Room Temperature Offset for single-point calibration<br>and SECURE MODE for Part 11 compliance<br>solution. |
| 550-767HN | 2931        | Various         | Low-speed<br>3-state<br>Or<br>Modulating | Discharge<br>Temp  | REHEAT<br>0-10V   | "Cascade" Control of Room Pressure by Resetting<br>Flow-Tracking Differential.<br>Room Temperature Offset for single-point calibration<br>and SECURE MODE for Part 11 compliance<br>solution.                         |

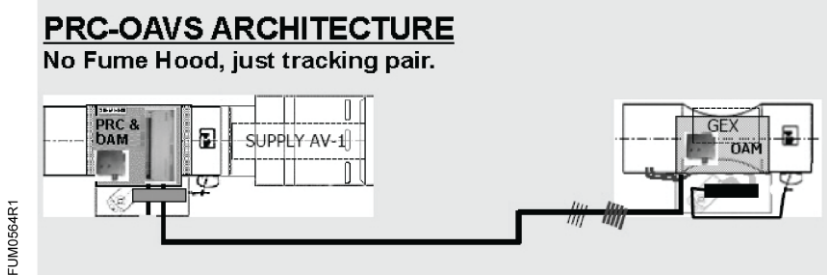

## Product Ordering

| Description   | Product Part Number              |
|---|----------------------------------|
| Lab Controller Module   | 550-767xN                        |
| Off-board Air Module<br><b>NOTE:</b> Enhanced 550-767xN laboratory controllers <b>must use 550-819B</b> Off-board Air Modules (OAM). Using 550-818B with enhanced 550-767xN controllers will not work.<br>550-818B OAM are to only be used for legacy 550-767x controllers. | 550-819B                         |
| Single Duct Supply Terminal   | LGSn...n                         |
| Dual Duct Supply Terminal   | LGDn...n                         |
| Exhaust Terminal  | LGE n...n                        |
| Airflow Measurement Station   | LGF n...n                        |
| Venturi Air Valve<br>– Constant Volume<br>– Variable Volume<br>– Zero Leakage Shut-Off  | AVCn...n<br>AVVn...n<br>AVZn...n |
| Venturi Air Valve Accessories   | AVAn...n                         |
| Laboratory Electronic Actuator  | GNP191.1P                        |
| TEC Duct Sensor Setpoint Adapter Kit  | 540-656                          |

## Document Information

| Description   | Product Part Number |
|---|---------------------|
| Fume Hood Controller Variable Air Volume            | 149-245             |
| Fume Hood Controller Constant Volume, 2-state (CV2) | 149-947             |
| Venturi Air Valves                                  | 149-425             |
| Conical Venturi Air Valve for Critical Environments | 149-524             |
| Venturi Air Valve Accessories                       | 149-495             |
| Laboratory Room Single Duct Supply Air Terminal     | 149-319             |
| Laboratory Exhaust Air Terminal                     | 149-320             |
| Laboratory Room Dual Duct Supply Air Terminal       | 149-338             |
| Laboratory Airflow Station                          | 149-317             |
| Laboratory Electronic Actuator Submittal Sheet      | 155-771             |

Information in this document is based on specifications believed correct at the time of publication. The right is reserved to make changes as design improvements are introduced. Product or company names mentioned herein may be the trademarks of their respective owners.  
© 2016 Siemens Industry, Inc.

**Siemens Industry, Inc.**  
Building Technologies Division  
1000 Deerfield Parkway  
Buffalo Grove, IL 60089-4513  
USA  
+1 847-215-1000

Your feedback is important to us. If you have comments about this document, please send them to [SBT\\_technical.editor.us.sbt@siemens.com](mailto:SBT_technical.editor.us.sbt@siemens.com).

Document No. 149-856  
Printed in the USA  
**Page 6 of 6**